Water and Wastewater Department Monthly Report
July 2015

Listed below is a summary of the activities the Water and Wastewater Department performed during July.

GENERAL

- Completed work orders for: Endpoint Installations: 3
  - Shut-Off Service: 0
  - Turn On Service: 2
  - Final Read: 1
  - Julie Locate Requests: 44
  - New Meters Installed: 0
  - Existing Meters Replaced With New Meters: 1
  - Total Work Orders: 6

WASTEWATER

- Approx. 14,273,000 gallons flowed into the treatment plant.
- Approx. 0 gallons were discharged.
- Approx. 2,320,000 gallons were irrigated.
- Treated wastewater irrigation has begun.
- The Discharge Monitoring Report (DMR) was completed and mailed to the IEPA.
- Quarterly irrigation report was completed and mailed to the IEPA.
- Routine sewer main jetting was completed.
- Completed weekly monitoring well readings.
- Completed mowing of all wastewater facilities.

Wastewater Flow into Plant

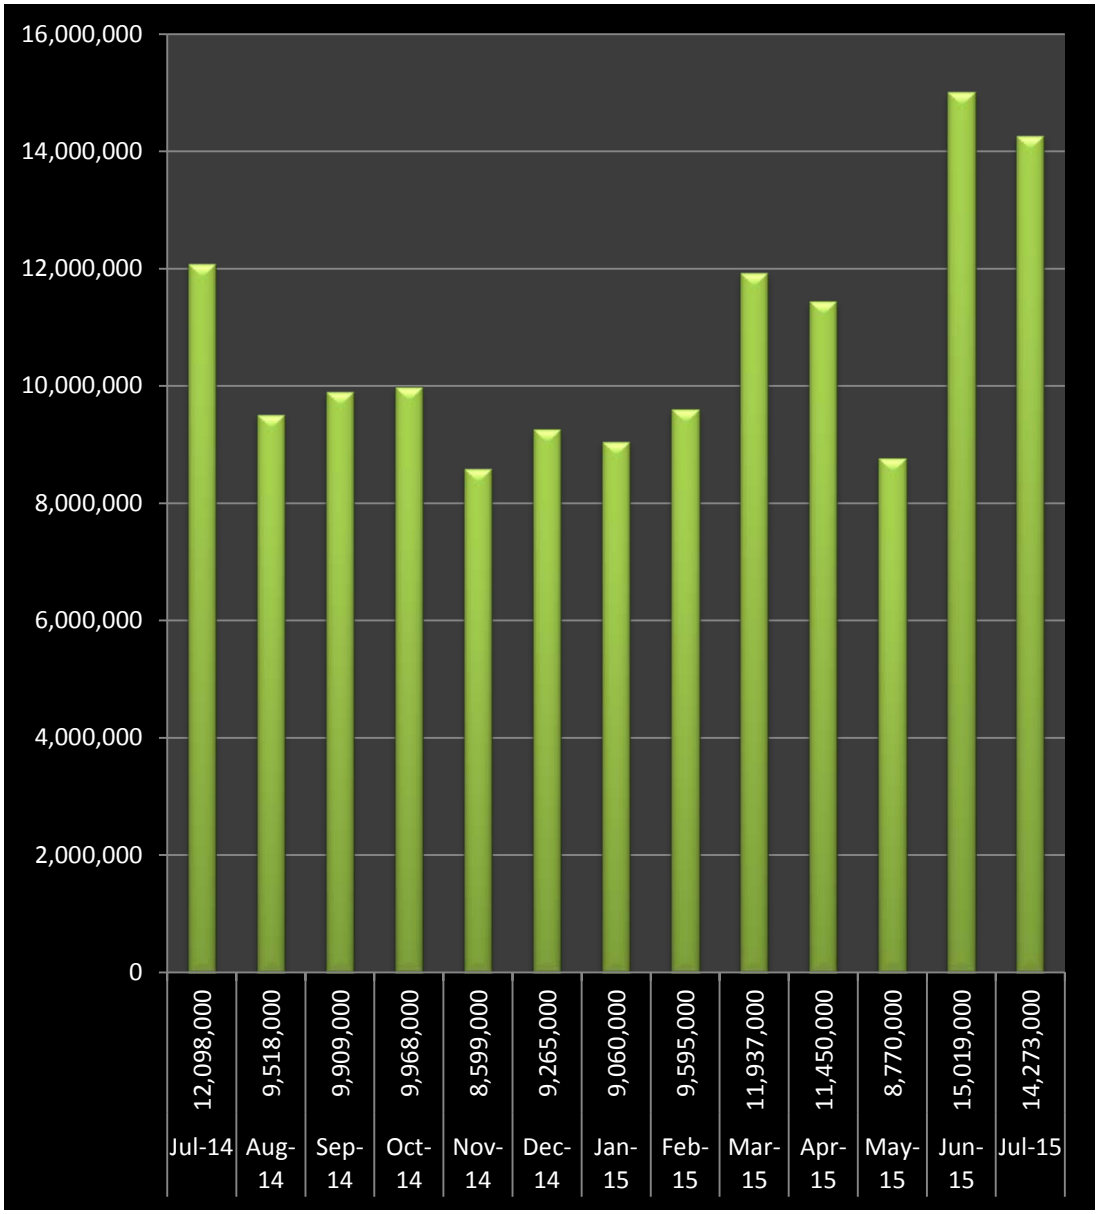

Treated Wastewater Irrigated

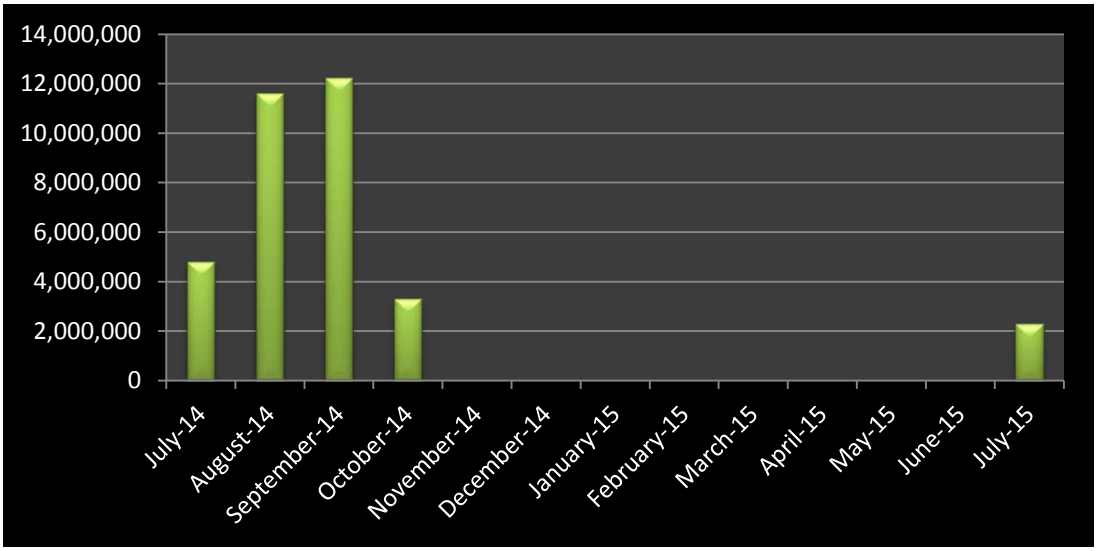

WATER

- Completed over 640 water quality tests. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA
- 12 Bact's and 4 Fluoride samples were collected.
- Staked out location of security fence at Well 4.
- Completed routine testing for Nitrites/Nitrates at Wells 1, 2, and 3.
- Completed mowing of all water facilities.

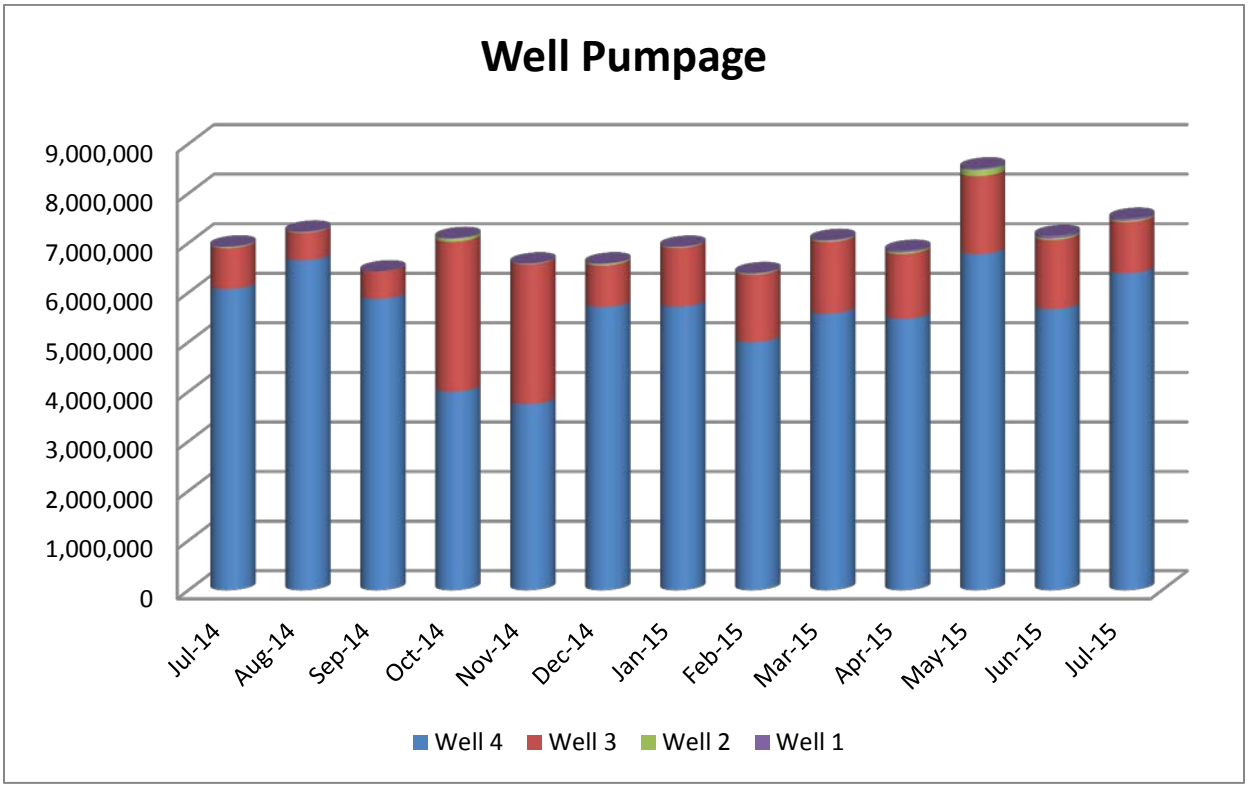

Well 1 45,300
Well 2 27,000
Well 3 1,034,880
Well 4 6,387,999

7,495,179 Gallons of Treated Water Was Pumped In July