Water and Wastewater Department Monthly Report
January 2015

Listed below is a summary of the activities the Water and Wastewater Department performed during January.

GENERAL

- Completed work orders for: Endpoint Installations: 4
  - Shut-Off Service: 1
  - Turn On Service: 0
  - Final Read: 3
  - Julie Locate Requests: 8
  - New Meters Installed: 0
  - Existing Meters Replaced With New Meters: 1
  - Total Work Orders: 8

WASTEWATER

- Approx. 9,060,000 gallons flowed into the treatment plant.
- Approx. 11,437,000 gallons were discharged.
- The Discharge Monitoring Report (DMR) was completed and mailed to the IEPA.
- 4th quarter irrigation report was completed and mailed to the IEPA.
- Completed routine wastewater sampling.
- Completed routine sewer main jetting.

Wastewater Flow Into Plant

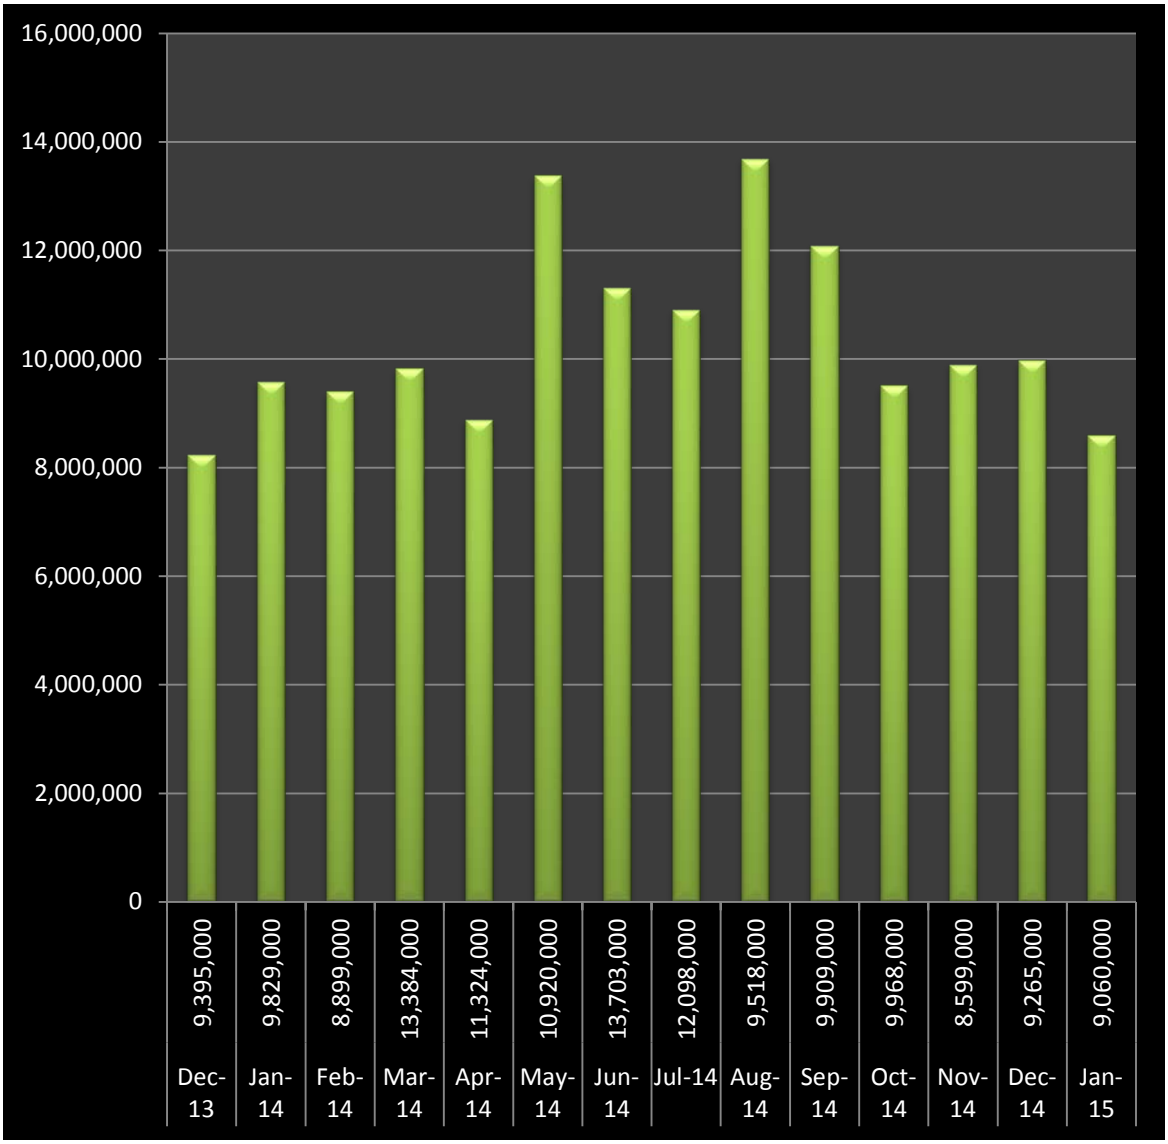

Treated Wastewater Discharged

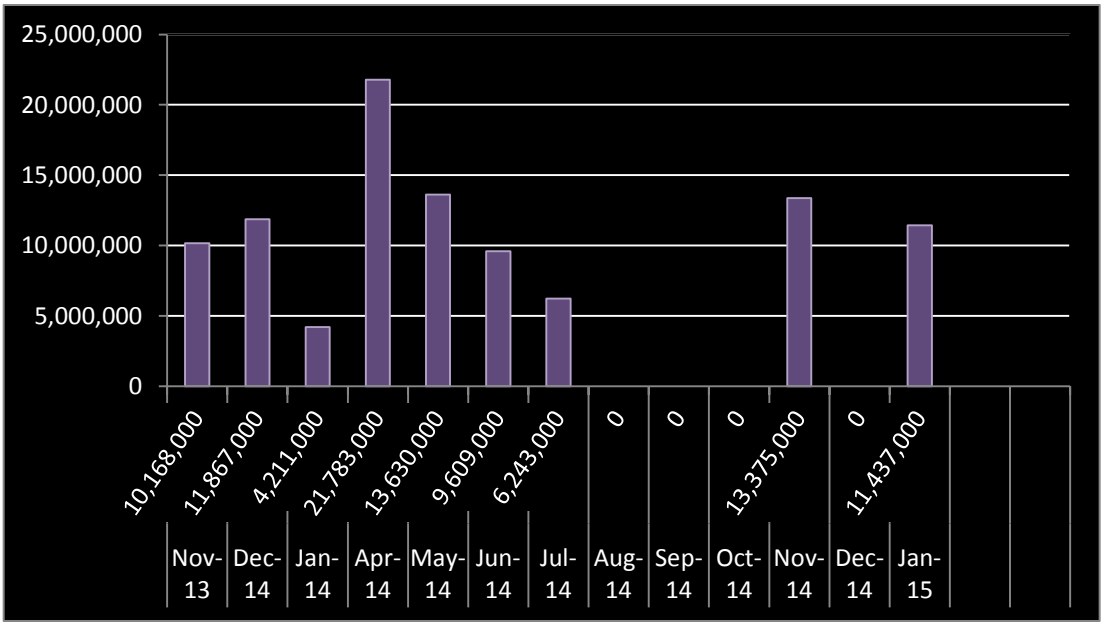

WATER

- Completed over 480 water quality tests. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA
- 12 Bact's and 4 Fluoride samples were collected.
- Completed routine sampling for radium and IOC's
- Posted 150 disconnection notices.
- Installed new pick up bed on the 2005 F250 truck.

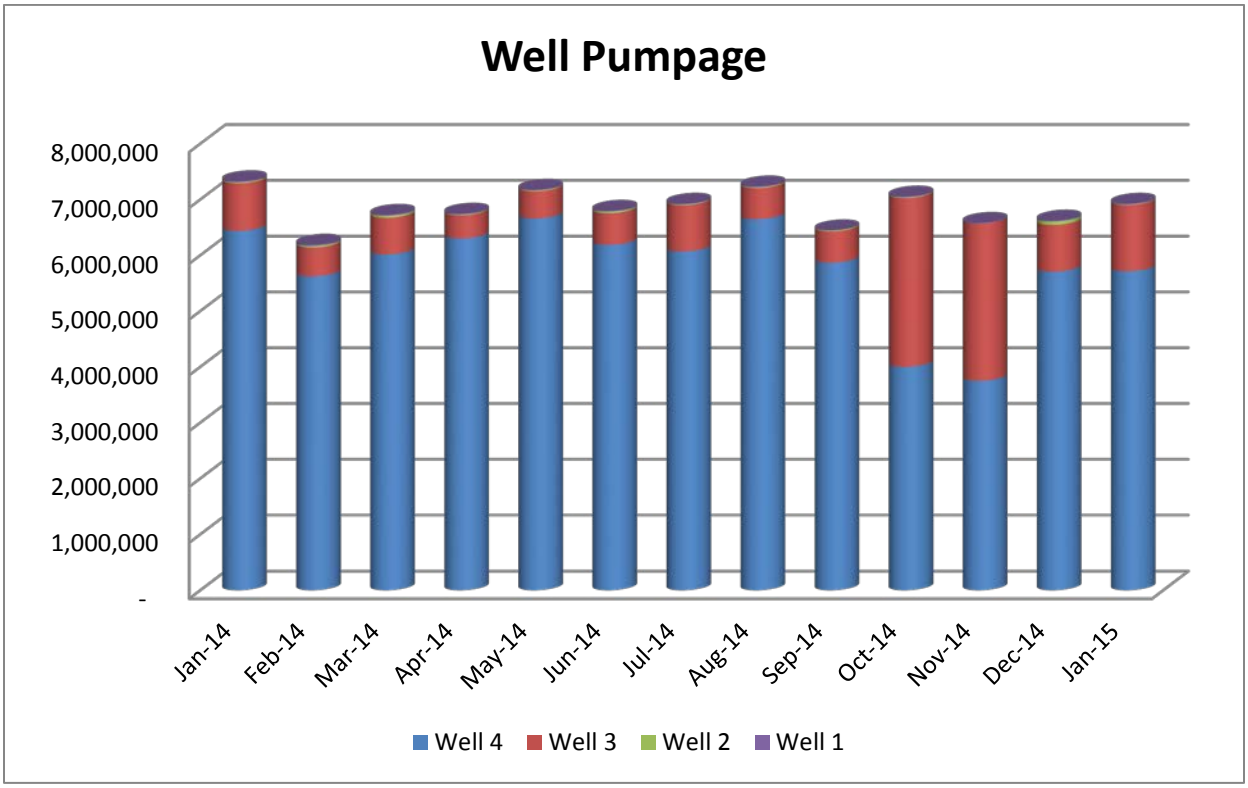

Well 1 15,100
Well 2 14,700
Well 3 1,187,760
Well4 5,712,599

6,930,159 Gallons Of Treated Water Was Pumped In January