Water and Wastewater Department Monthly Report

March 2020

Listed below is a summary of the activities the Water and Wastewater Department performed during March.

GENERAL

- Met with Cortland Mobile Home Community about their renewed interest in the Town providing water and wastewater services to their park.
- Worked on new budget
- Started a monthly safety training session for the water/wastewater department
    - Completed work orders for:

Shut-Off Service:	0
Turn On Service:	0
Final Read:	2
Courtesy Read:	0
Julie Locate Requests:	40
New Meters Installed:	0
Existing Meters Replaced With New Meters:	5
Other:	1
Total Work Orders:	7

WASTEWATER

- Approx. 13,027,000 gallons flowed into the treatment plant.
- Approx. 19,931,000 gallons were discharged
- The Discharge Monitoring Report (DMR) was completed and filed with the IEPA.
- Completed monthly sampling.
- Completed blower maintenance at the STP.
- Repaired rear door of the Vactor
- Completed routine jetting.

Influent

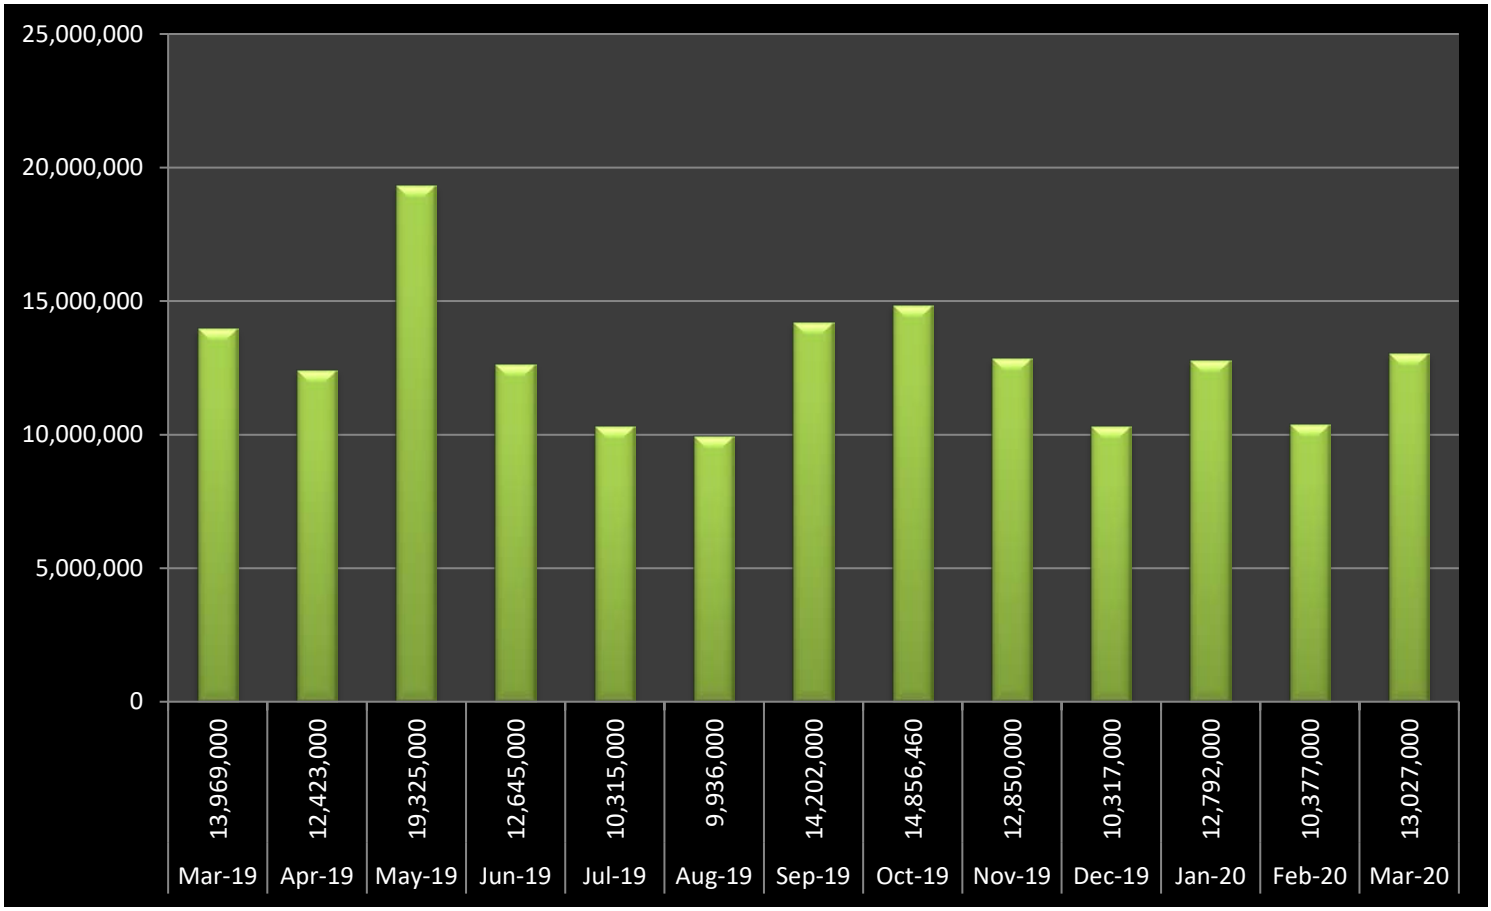

Effluent Discharge

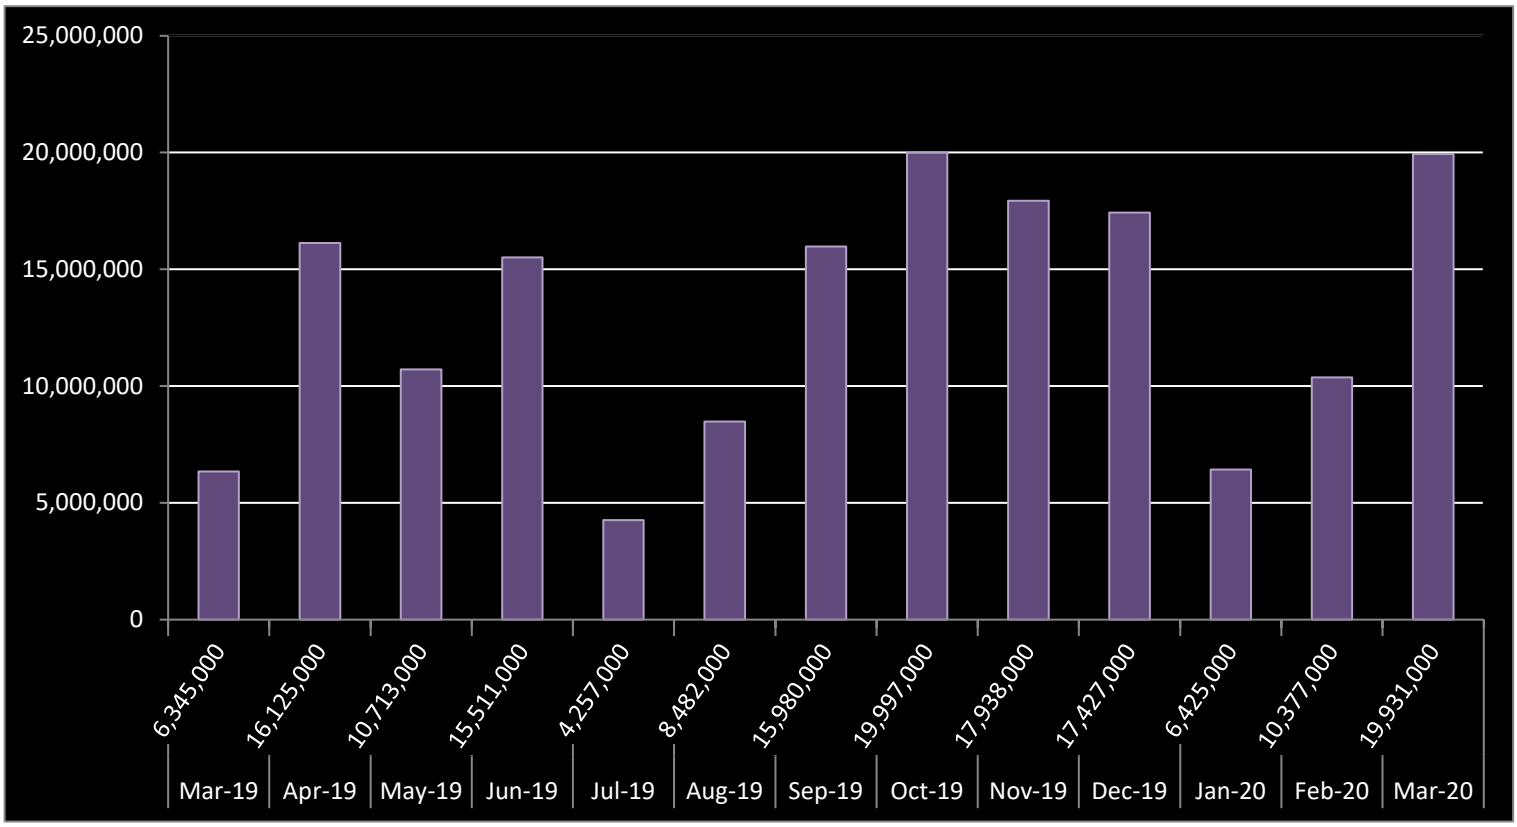

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly sampling.
- Completed fire hydrant maintenance on 24 hydrants.
- Excavate the area of Walnut and Robinson for water main location.
- Completed IEPA Service Line Material Report

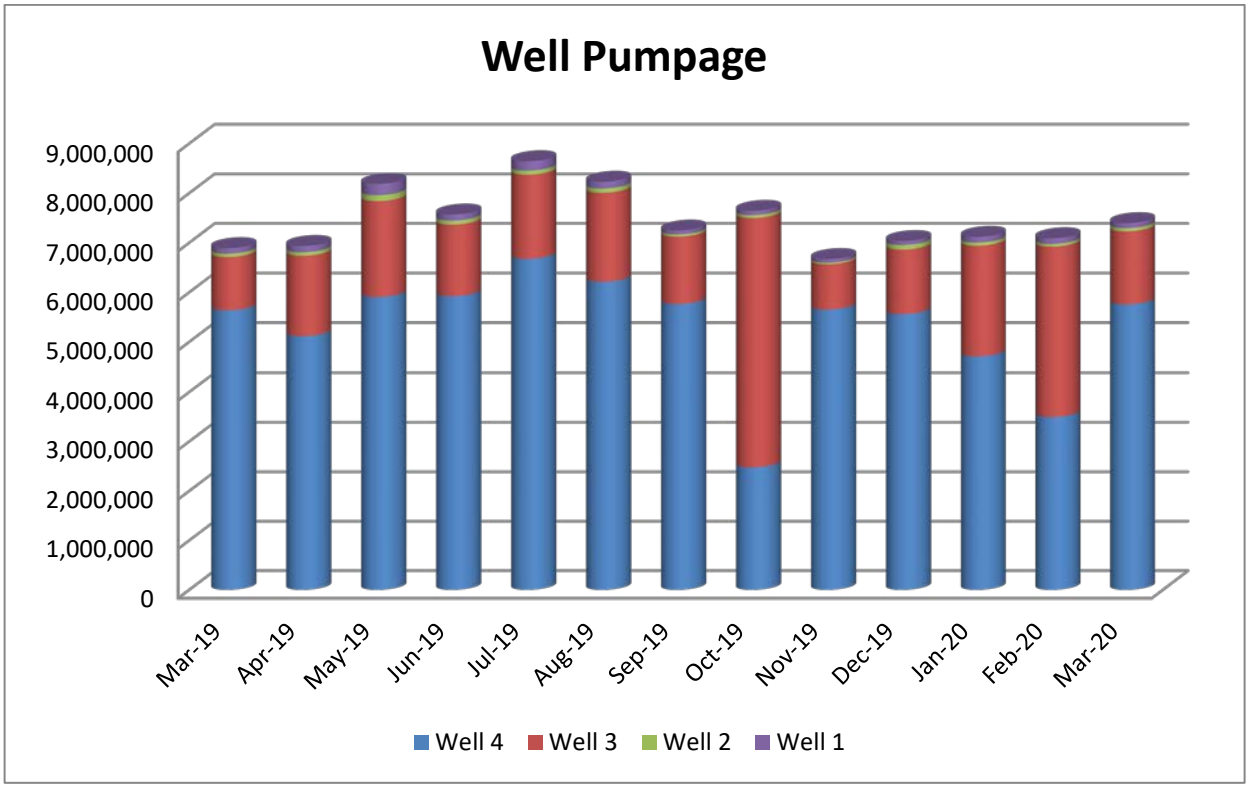

Well 1	99,300
Well 2	65,800
Well 3	1,474,000
Well 4	5,756,500

Total pumpage of treated water from wells for March: 7,395,600