Water and Wastewater Department Monthly Report

January 2020

Listed below is a summary of the activities the Water and Wastewater Department performed during January.

GENERAL

- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	0
Final Read:	6
Courtesy Read:	0
Julie Locate Requests:	**41**
New Meters Installed:	0
Existing Meters Replaced With New Meters:	12
Other:	2
Total Work Orders:	18

WASTEWATER

- Approx. 12,792,000 gallons flowed into the treatment plant.
- Approx. 6,425,000 gallons were discharged
- The Discharge Monitoring Report (DMR) was completed and filed with the IEPA.
- Completed monthly sampling.
- Continued work on ceiling.
- Completed quarterly monitoring well sampling.

Influent

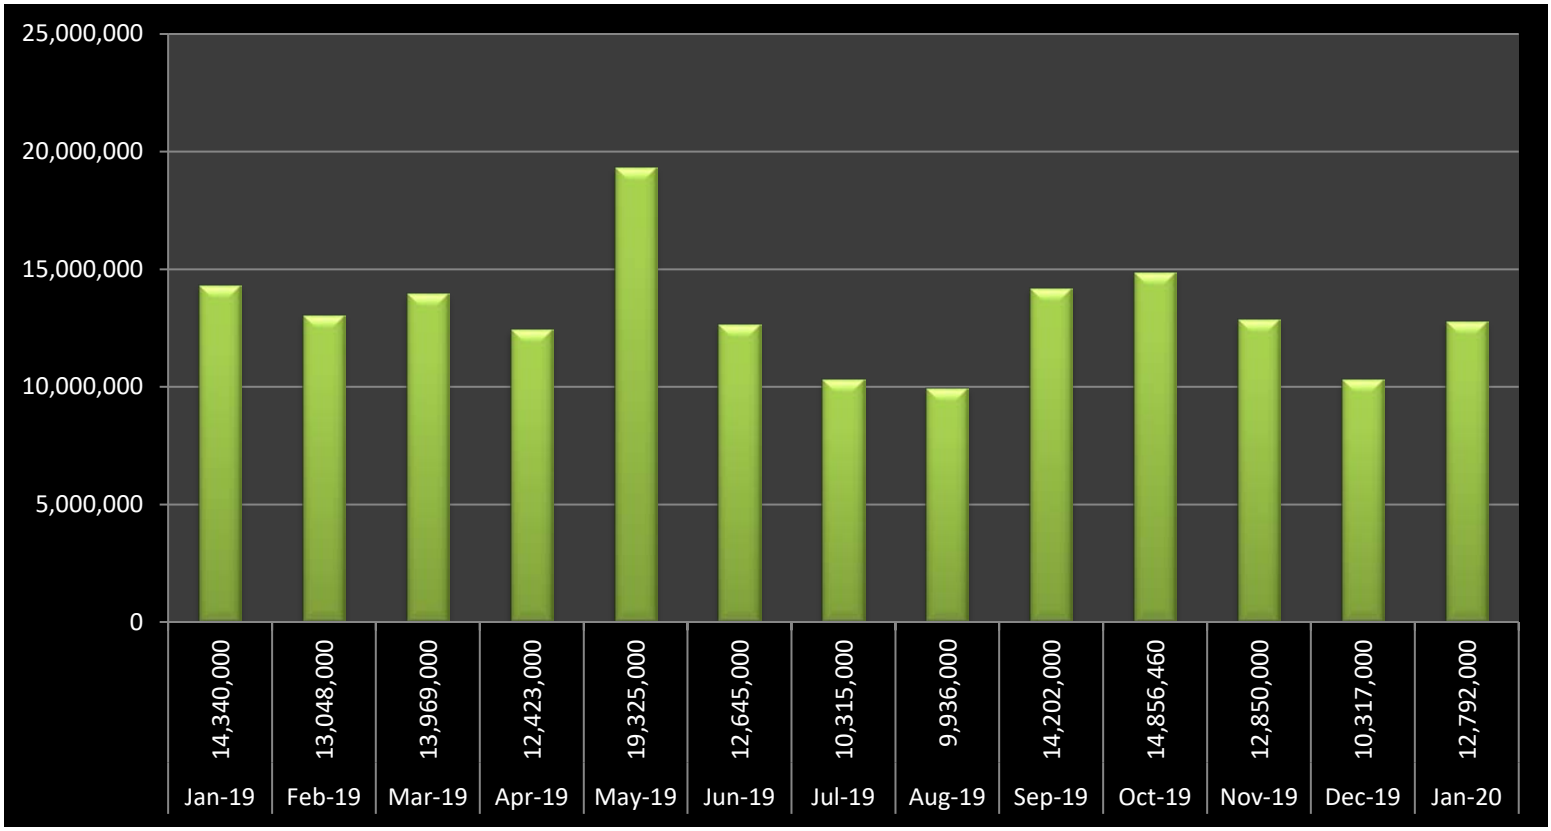

Effluent Discharge

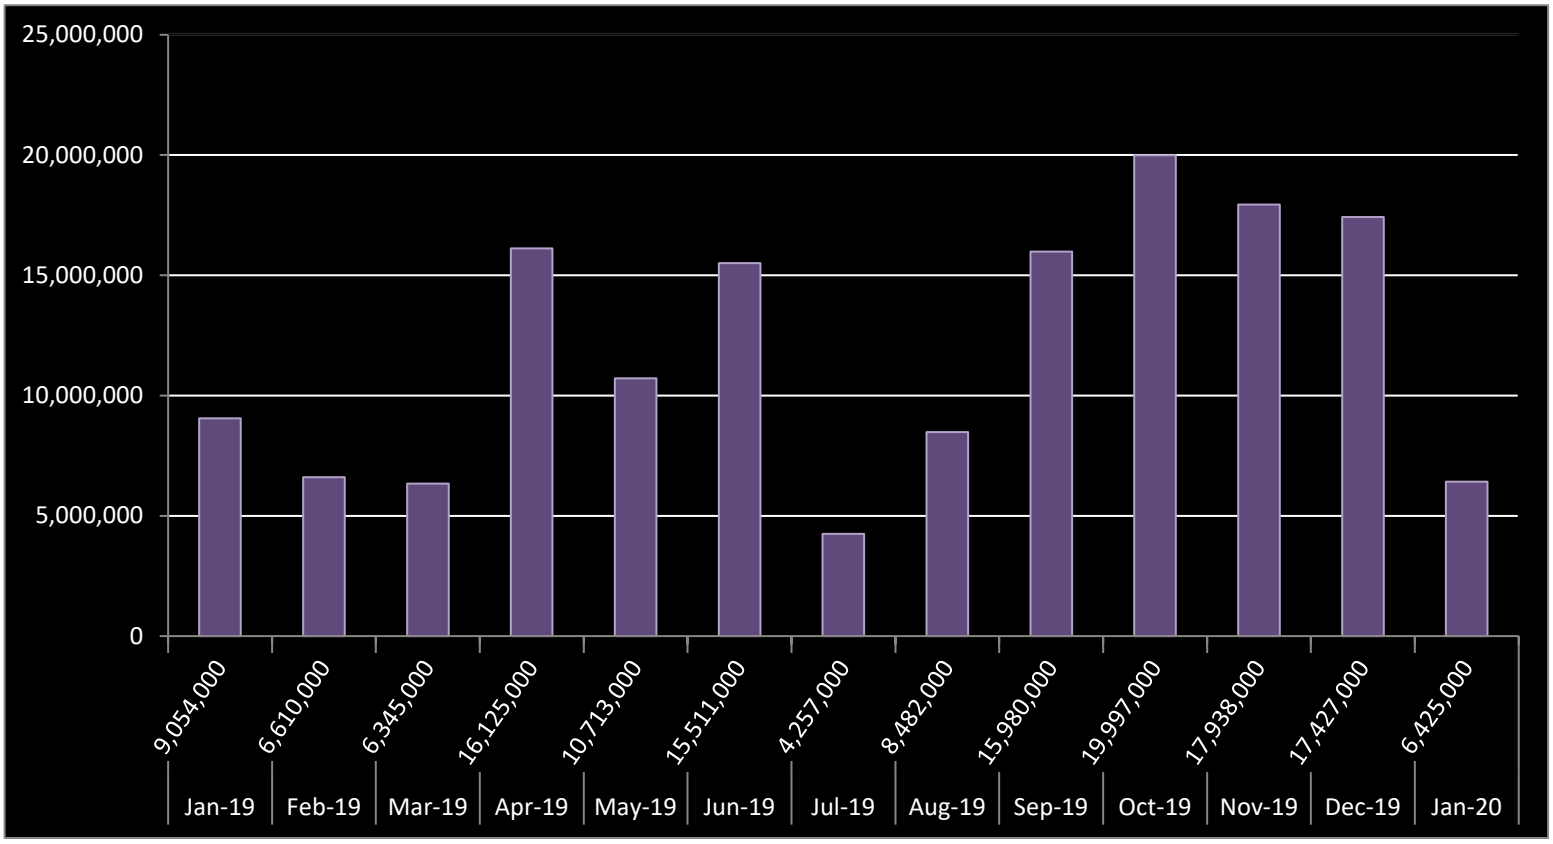

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly sampling.
- Completed routine VOC and SOC sampling at the wells.

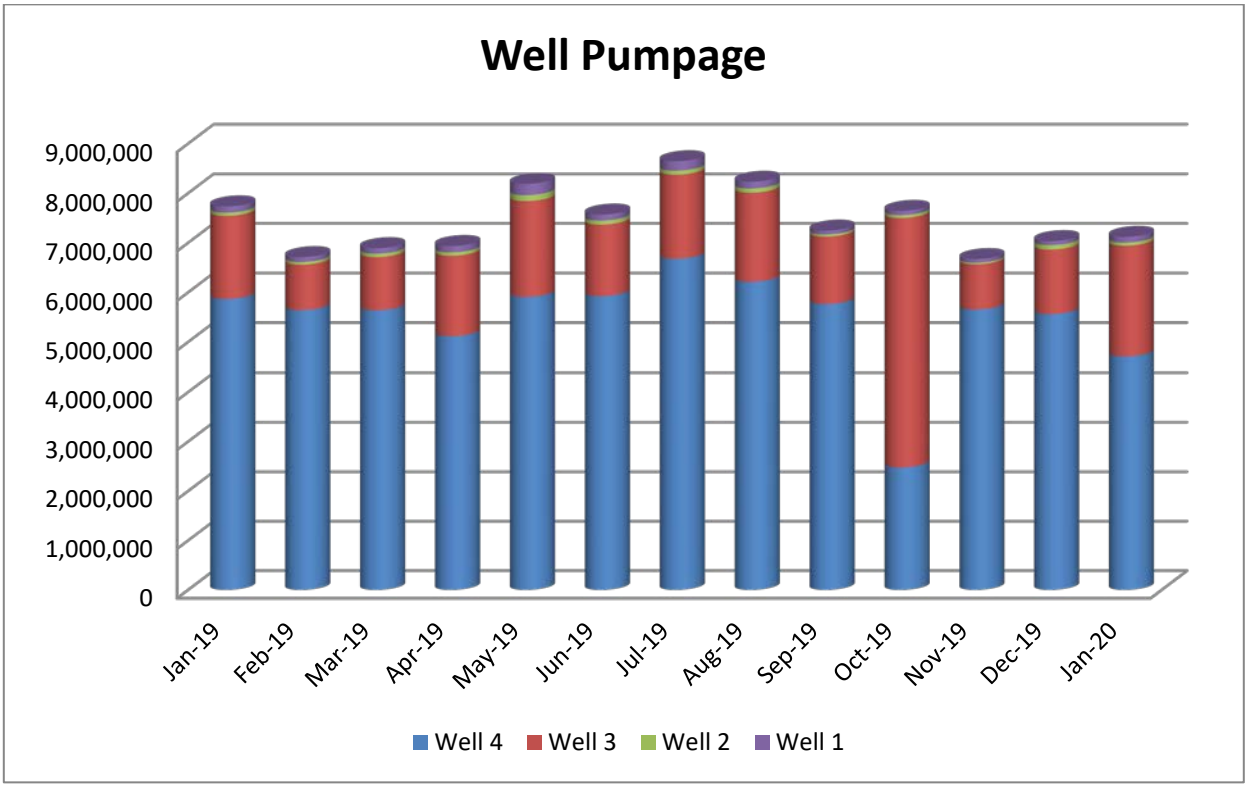

Well 1 114,900
Well 2 64,500
Well 3 2,232,000
Well 4 4,708,500

Total pumpage of treated water from wells for Januaury: 7,119,900