Water and Wastewater Department Monthly Report

June 2020

Listed below is a summary of the activities the Water and Wastewater Department performed during June.

GENERAL

- Completed work orders for:

Shut-Off Service:	0
Turn On Service:	2
Final Read:	5
Courtesy Read:	2
Julie Locate Requests:	**131**
New Meters Installed:	0
Existing Meters Replaced With New Meters:	3
Other:	1
Total Work Orders:	13

WASTEWATER

- Approx. 11,406,000 gallons flowed into the treatment plant.
- Approx. 21,260,000 gallons were discharged
- The Discharge Monitoring Report (DMR) was completed and filed with the IEPA.
- Completed monthly sampling.
- Mowed all wastewater facilities.
- Completed sewer main jetting.
- Repaired 13 aerators in the STP lagoons.
- Vactor truck was run through the test lane.

Influent

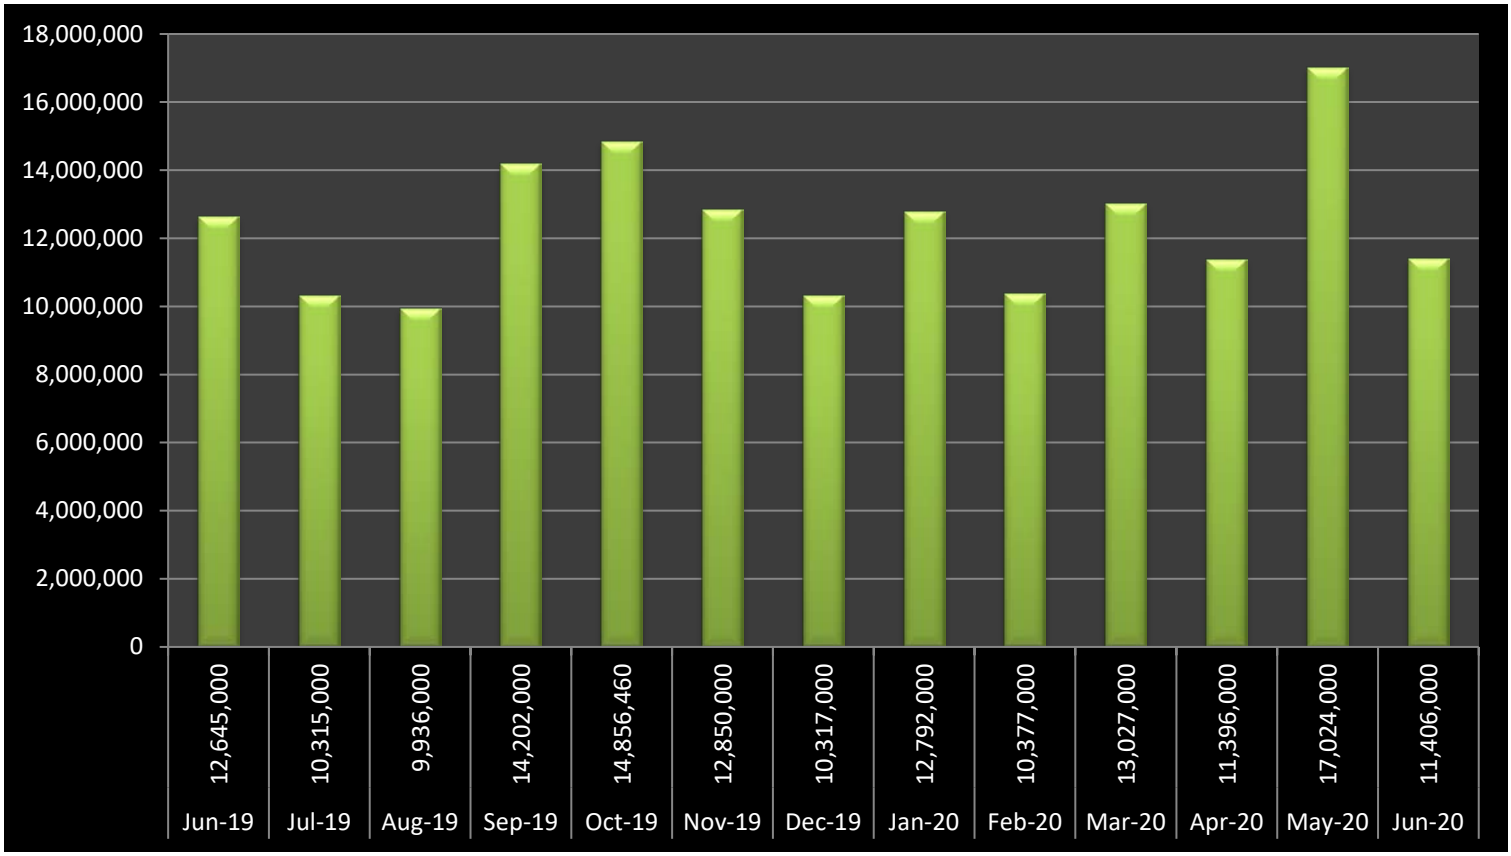

Effluent Discharge

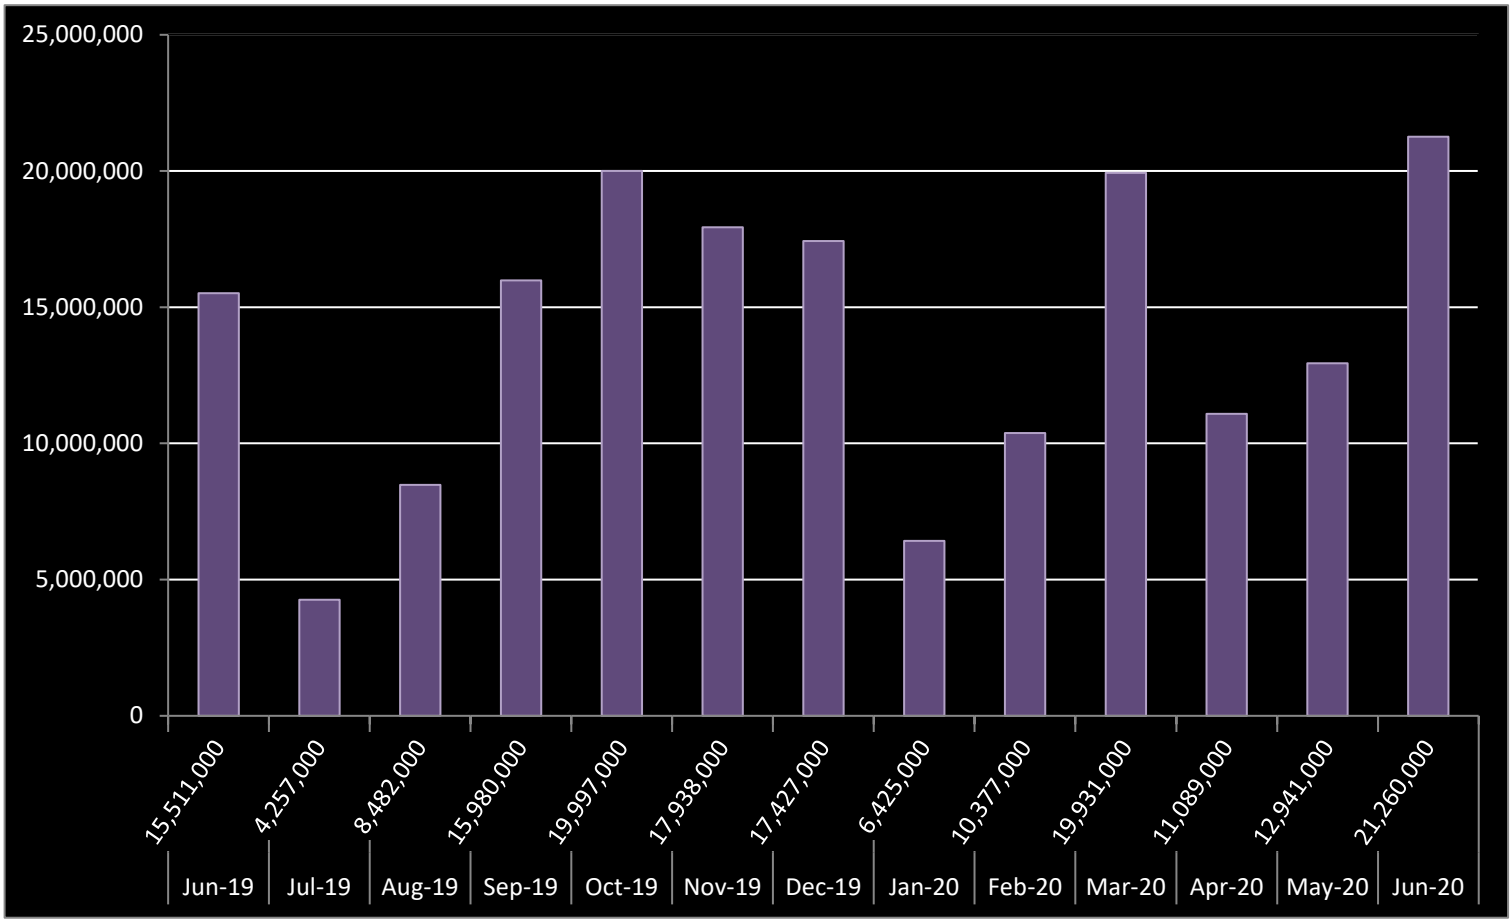

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly sampling.
- Prepared pumping numbers for town audit.
- Raised 2 valves.
- Rebuilt 1 CL2 pump.

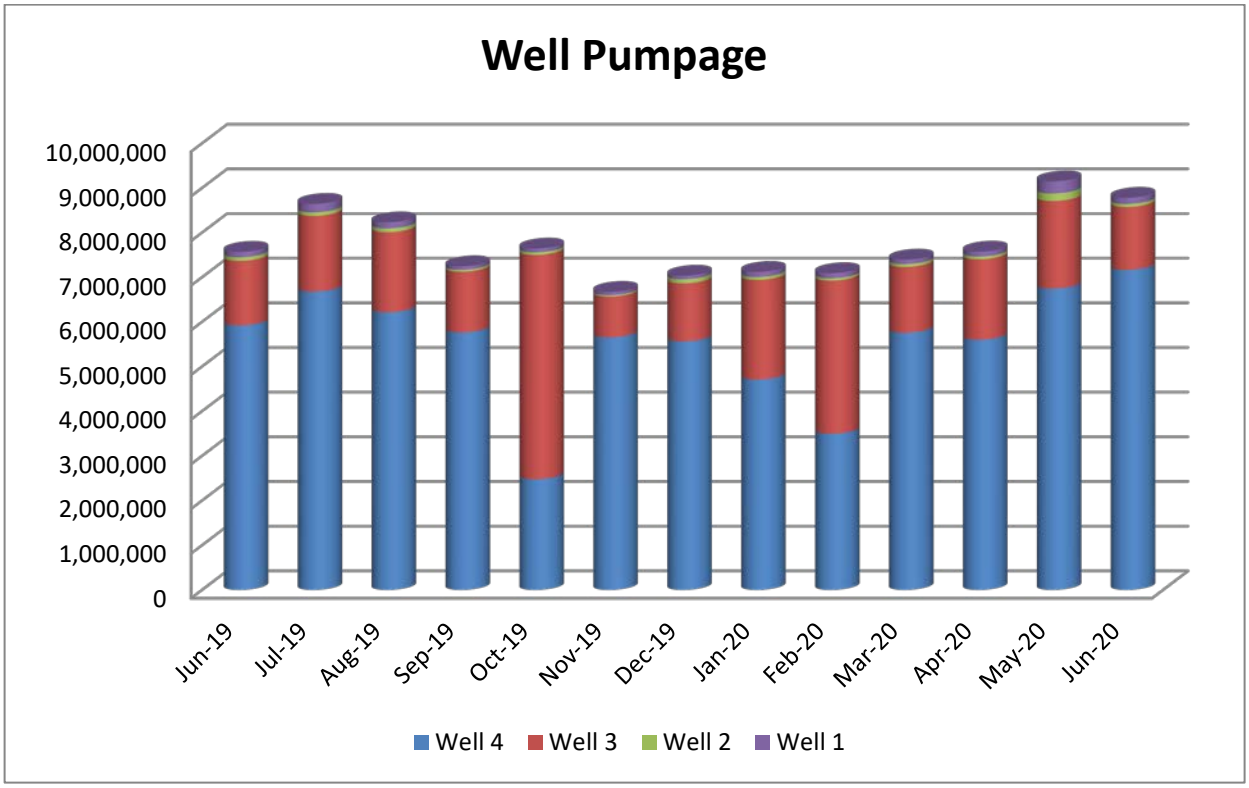

Well 1	137,800
Well 2	69,100
Well 3	1,410,000
Well 4	7,163,700

Total pumpage of treated water from wells for June: 8,780,600