Water and Wastewater Department Monthly Report

July 2019

Listed below is a summary of the activities the Water and Wastewater Department performed during July.

GENERAL

- Completed work orders for: Endpoint Installations: 0

Shut-Off Service:	2
Turn On Service:	1
Final Read:	6
Courtesy Read:	2
Julie Locate Requests:	**925**
New Meters Installed:	4
Existing Meters Replaced With New Meters:	0
Other:	
Total Work Orders:	12

WASTEWATER

- Approx. 10,315,000 gallons flowed into the treatment plant.
- Approx. 4,257,000 gallons were discharged
- The Discharge Monitoring Report (DMR) was completed and filed with the IEPA.

Influent

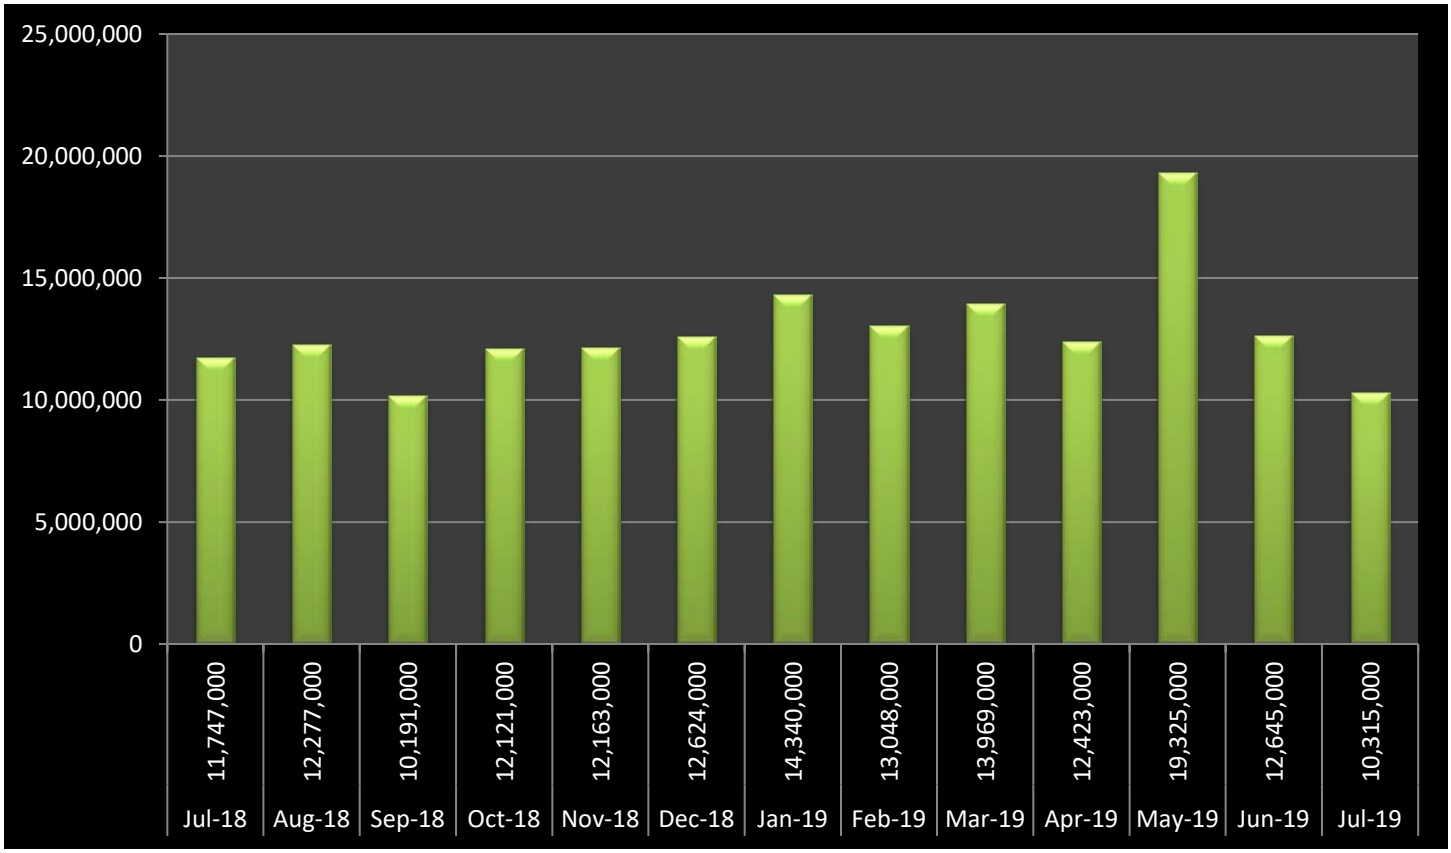

Effluent Discharge

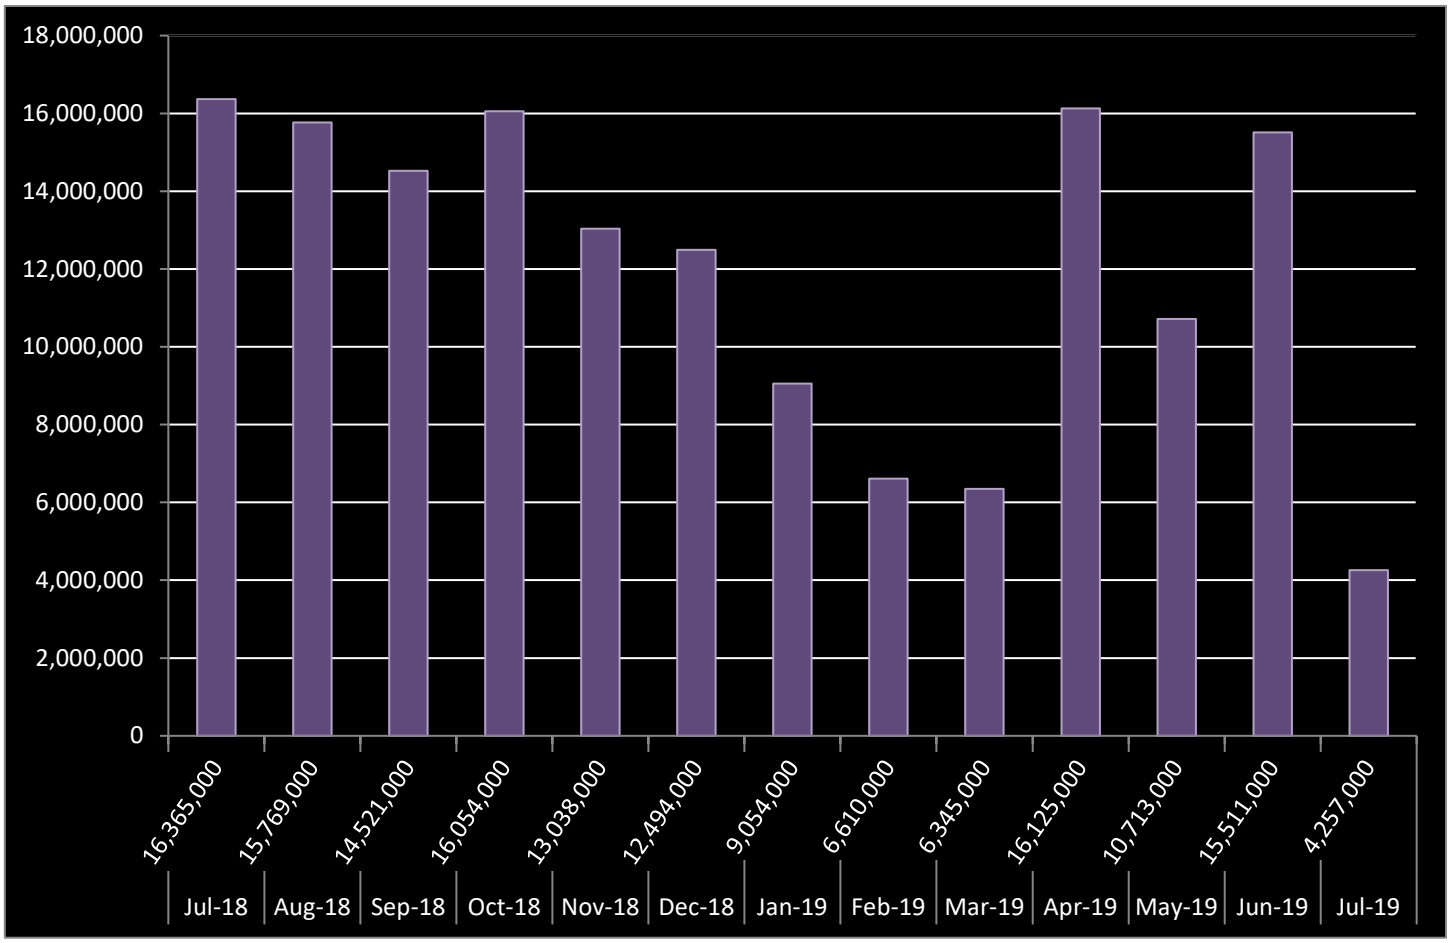

WATER

- Completed daily lab samples related to water quality. (pH, Fluoride, Chlorine, Hardness)
- Monthly chemical injection reports were complete and mailed to the IEPA.
- Completed monthly routine samples.
- Repaired a water service break under a driveway on Aspen Dr.
- Completed water meter reading for utility billing.

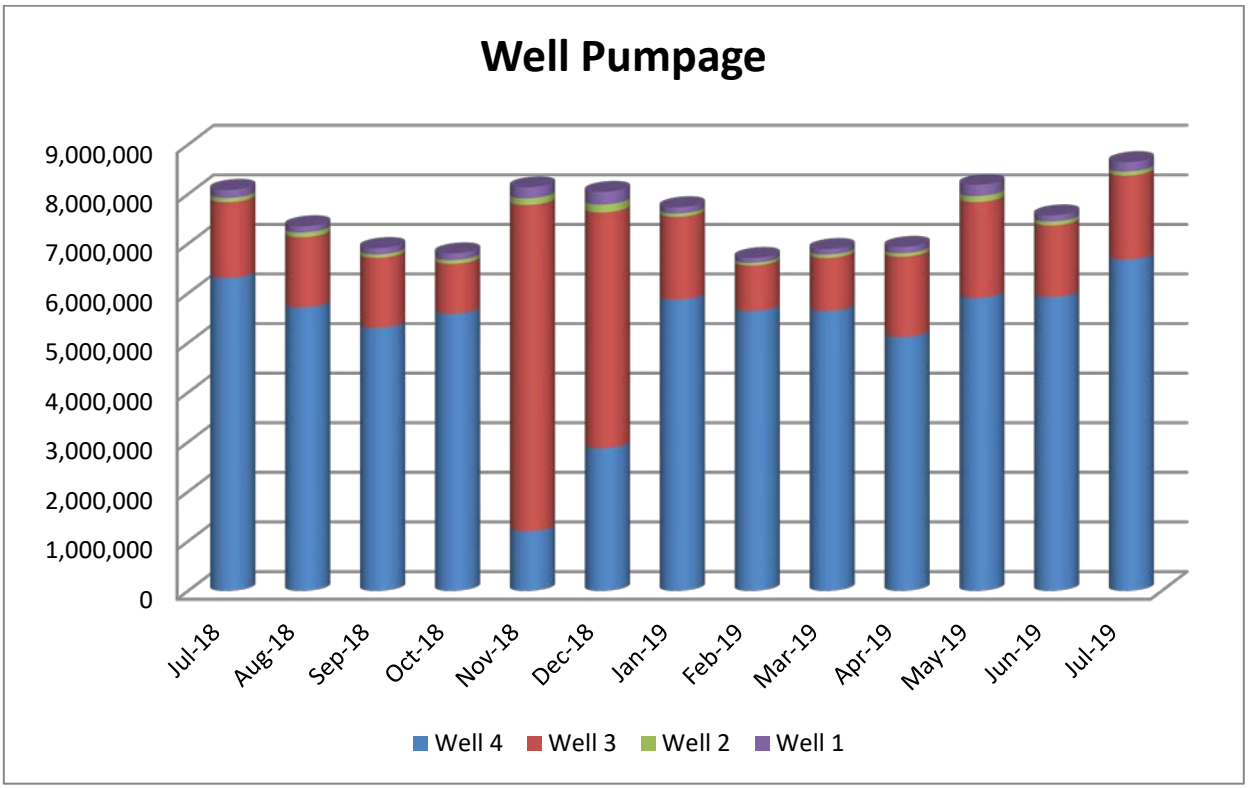

Well 1	189,400
Well 2	80,900
Well 3	1,696,000
Well 4	6,677,700

Total pumpage of treated water from wells for July: 8,644,000